



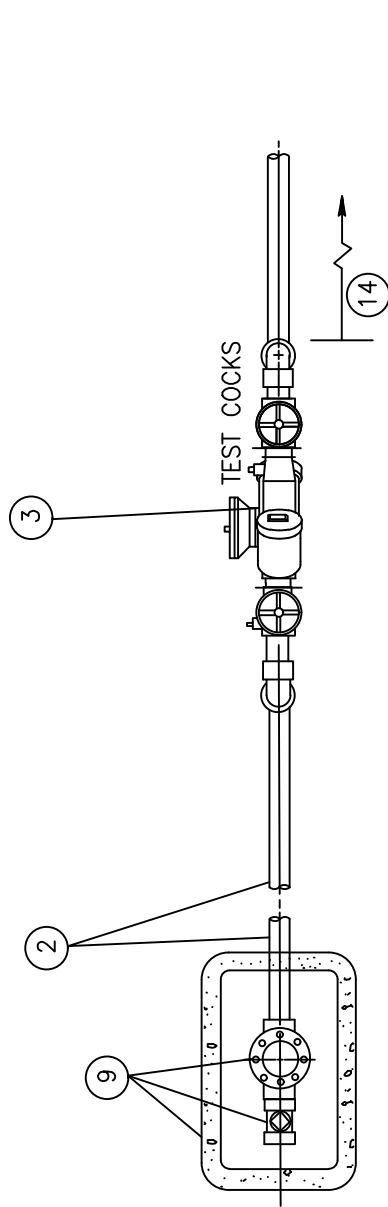

PLAN

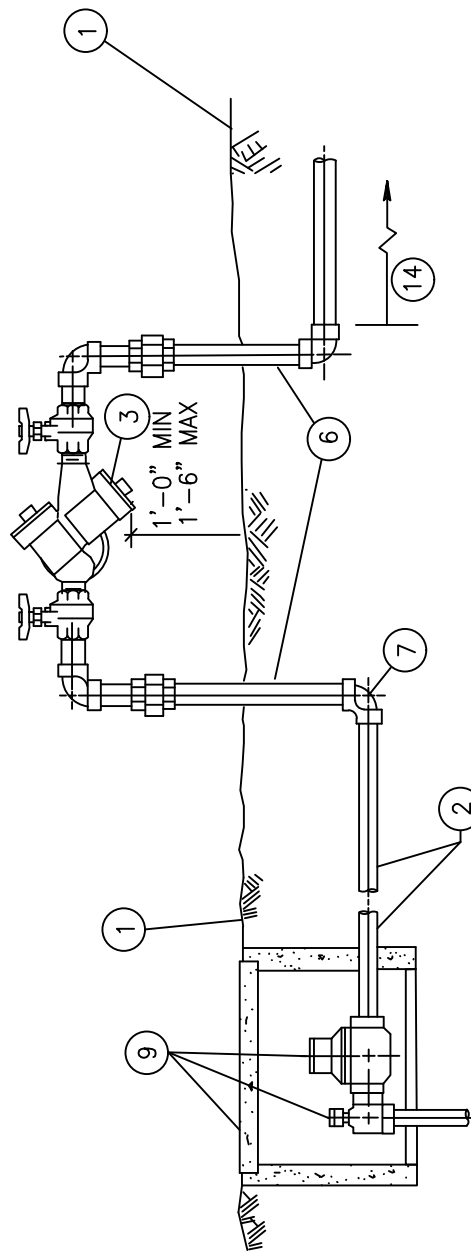

PROFILE

FOR NOTES AND LEGEND, SEE DETAIL W-10

NOTE: (FOR SIZES 1" TO 2" BACKFLOW UNITS SHALL BE LF FEBCO 825 Y LEAD FREE OR APPROVED EQUAL)

1. PIPING BETWEEN BACKFLOW DEVICE AND METER SHALL BE EXPOSED FOR INSPECTION BY THE UTILITY SYSTEMS
2. BACKFLOW ASSEMBLY MUST BE THE SAME SIZE AS THE METER AT A MINIMUM OF 1" or 1 to 1 RATIO.
3. BACKFLOW DEVICE SHALL BE PLACED DIRECTLY BEHIND SIDEWALK OR DIRECTLY BEHIND METER BOX FOR ATTACHED SIDEWALK CONFIGURATIONS.
4. BACKFLOW DEVICES OWNED AND MAINTAINED BY THE CITY OF MORGAN HILL SHALL BE EQUIPPED WITH LOCKABLE CAGES (SEE DETAIL L-10).



City of Morgan Hill
Public Works Department

S.E.
CITY ENGINEER

4/1/96
DATE

3/06/23
REVISED

REDUCED PRESSURE BACKFLOW PREVENTER (SIZES 1" TO 2")

DRAWING
NO.

W-6