



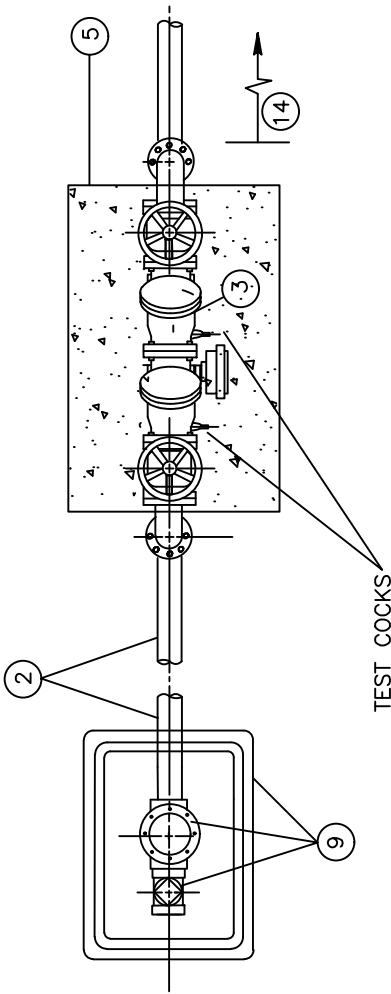

PLAN

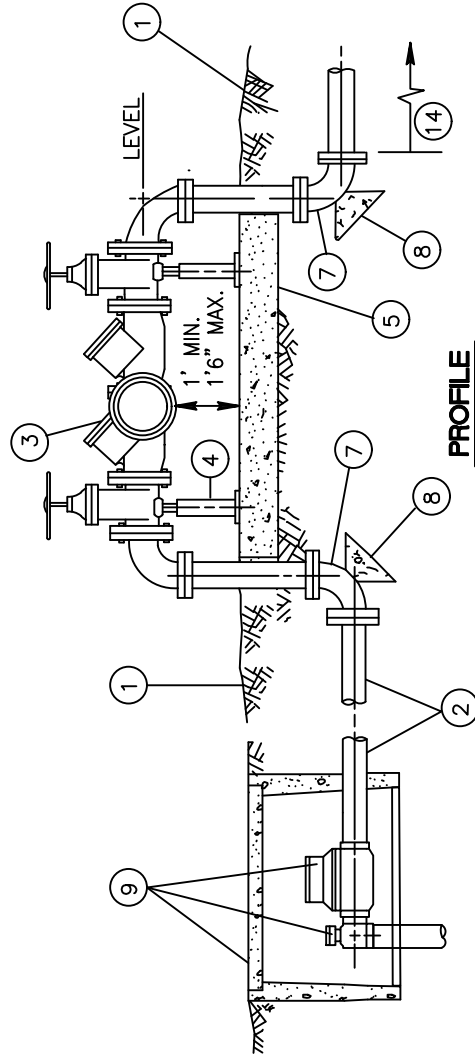

PROFILE

FOR NOTES AND LEGEND, SEE DETAIL W-10

(FOR SIZES 2 1/2" TO 4" BACKFLOW UNITS SHALL BE LF FEBCO 825 YD OR APPROVED EQUAL)

NOTES:

1. PIPING BETWEEN BACKFLOW DEVICE AND METER SHALL BE EXPOSED FOR INSPECTION BY THE CITY.
2. FOR METER SIZES GREATER THAN 2 1/2", SEE DETAILS W-9 AND W-11.



City of Morgan Hill
Public Works Department

S.E.
CITY ENGINEER

4/1/96
DATE

3/06/23
REVISED

**REDUCED PRESSURE
BACKFLOW PREVENTER
(SIZES 2-1/2" TO 4")**

DRAWING
NO.
W-7